


Structure Connection - Option 2

FWC Wall Fitting Exact Fit

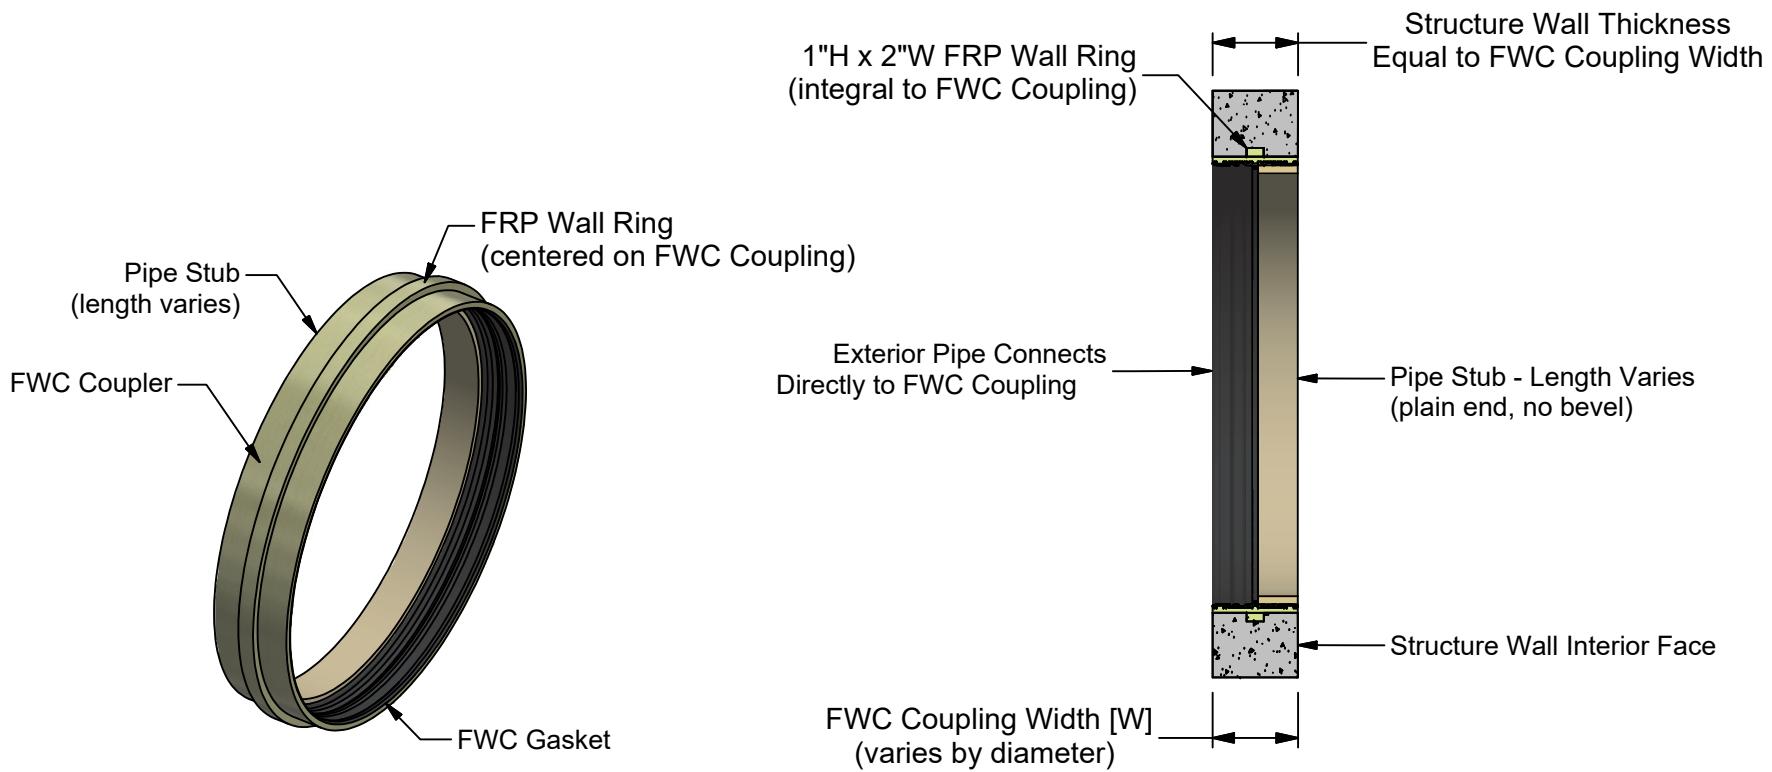

Installed Section View
(NTS)

FWC Width by Pipe Nominal Diameter		
(W)	Min Dia.	Max Dia.
~ 8.0"	18in	20in
~ 10.0"	24in	54in
~ 11.5"	57in	78in
~ 13.75"	84in	126in

Notes:

1. See Appendices "B" and "C" of our HOBAS Design Guide for pipe and FWC weights and diameters.
2. Wall fitting designed for a perpendicular connection to a flat (non-curved) structure wall.
3. See "HOBAS Rigid Connections" technical sheets for information on placement of pipe joints outside of structure wall.
4. Proper side support and longitudinal support of pipes entering or exiting structure must be achieved.
5. Settlement of structure and/or pipes entering the structure must be controlled (minimized).

HOBAS Pipe USA
 1413 E. Richey Road
 Houston, Texas 77073
 281-821-2200
www.hobaspipe.com



HOBAS®